



# Caledonian


Mining Cables (AS\_NZS Standard)

[www.caledonian-cables.com](http://www.caledonian-cables.com)

[marketing@caledonian-cables.com](mailto:marketing@caledonian-cables.com)

## AS/NZS 1972:2006 Cables

Type 1 1.1/1.1KV Collectively Screened 6C1.5

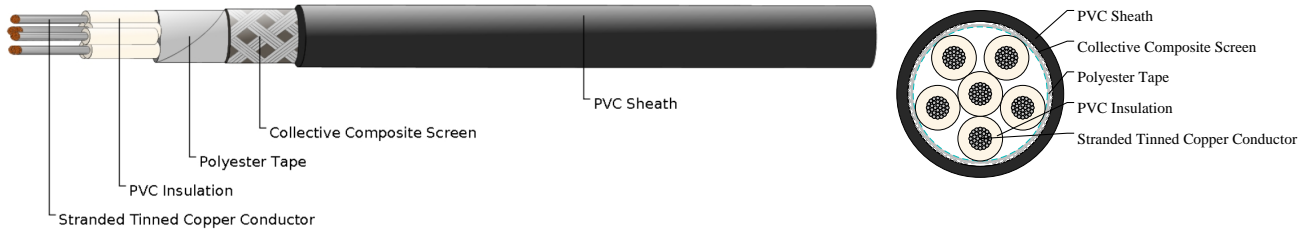

## APPLICATIONS

These collectively copper screened cables are used for wiring of machines, or between machines and equipment where PVC is suitable.

## STANDARDS

AS/NZS 1972:2006

AS/NZS 1125

AS/NZS 3808

## CABLE CONSTRUCTION

Conductors: Stranded copper conductor.

Insulation: PVC.

Bedding: Polyester tape.

Collective Composite Screen (earth conductor): Tinned annealed copper braiding interwove with polyester yarn.

Sheath: PVC sheath.

## DIMENSION AND PARAMETERS

No. of Cores	Nominal Cross-sectional Area	No./ Nominal Diameter of Strands	Core Screen Strand Size	Core Screen Area of Screen	Nominal Insulation Thickness	Nominal Sheath Thickness	Nom. Overall Diameter	Approx. Weight
	mm <sup>2</sup>	no./mm	no./mm	mm <sup>2</sup>	mm	mm	mm	kg/km
6	1.5	30/0.25	0.2	3.4	0.8	0.8	12.6	25